



SECTION 3.7_KSFL

FLAME ARRESTER DEFLAGRATION PROOF IN-LINE

INTRODUCTION

 **The model KSFL** inline flame arrester is designed, manufactured, tested according to API 2000, and ISO 16852. The units are passive devices with no moving parts. They prevent the propagation of flame from the exposed side of the unit to the protected side by the use of a 316L stainless steel crimped metal ribbon type flame cell element. This construction produces a matrix of uniform opening that are carefully constructed to quench the flame by absorbing the heat.

Operating Temperature @ Pressure

KSFL / DN 50 ~ DN 300

+ 60°C (=140°F) @ 0.11 Mpa


 **Body Materials** Aluminium, Nodular Iron, Cast Steel, SS304, SS316, SS316L with various trims
(Different materials available on request)

 **Sizes range** DN 50 ~ DN 300 with ASME 150Lb flanges
(Different connections available on request)


 **Rules & Certifications** API 2000 / ISO 16852
Flame cell : NEC group D (=IIA), group C(=IIB3) and group B(=IIC), ETC.

 **Optimum / optional Design & Arrangements** Steam jacket type

APPLICATION

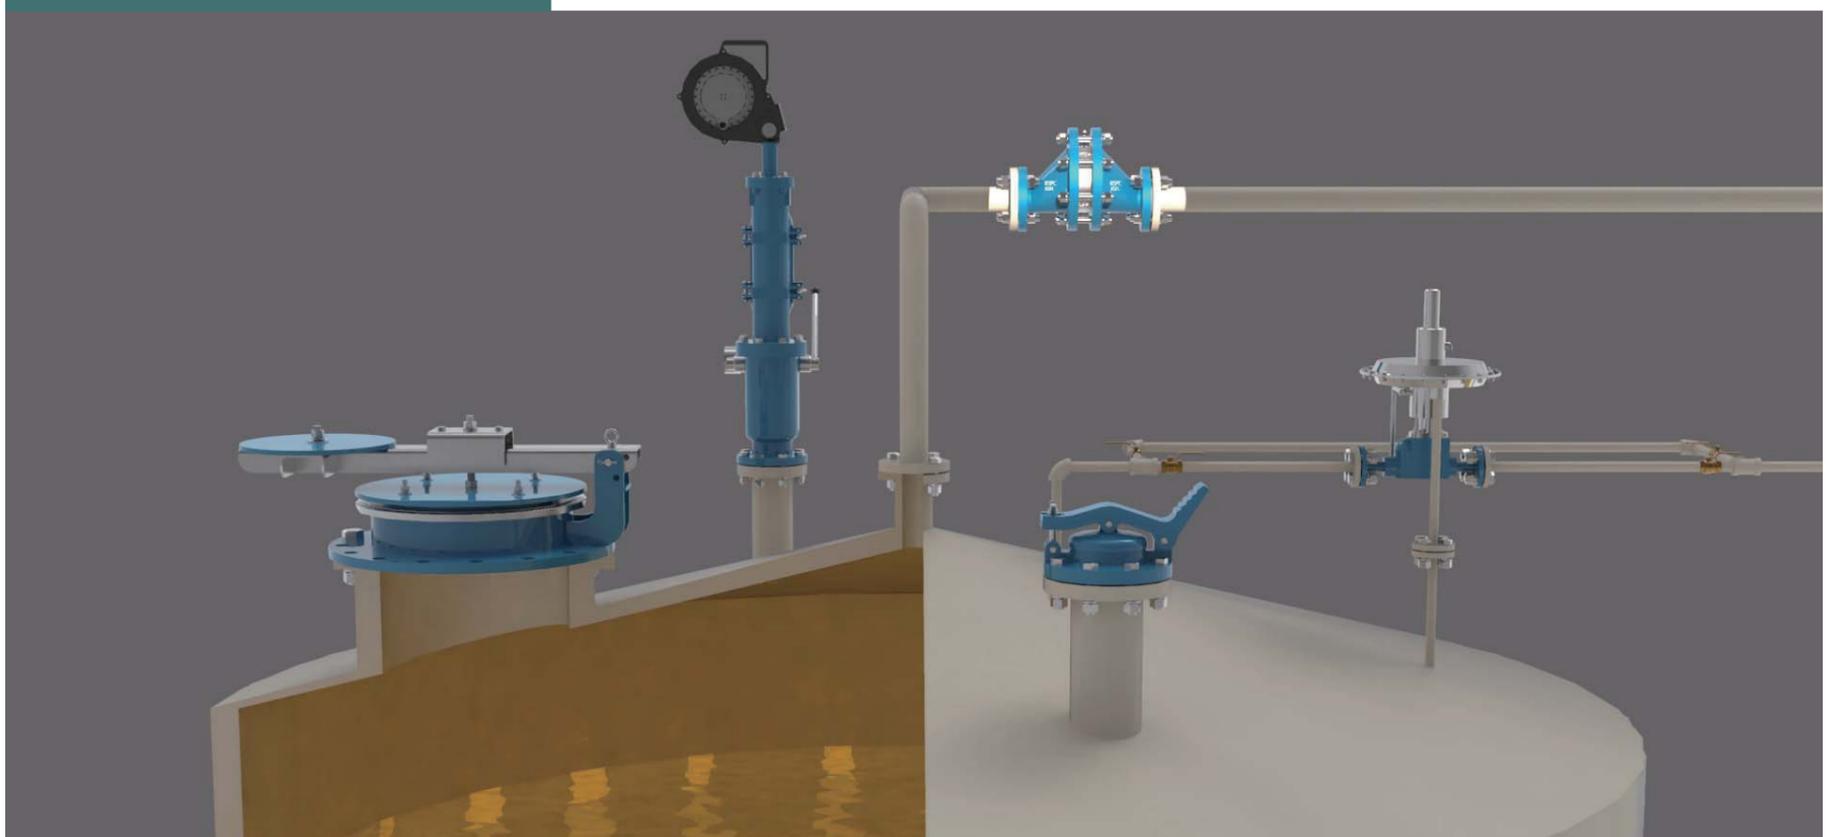

OUTLINE DRAWING

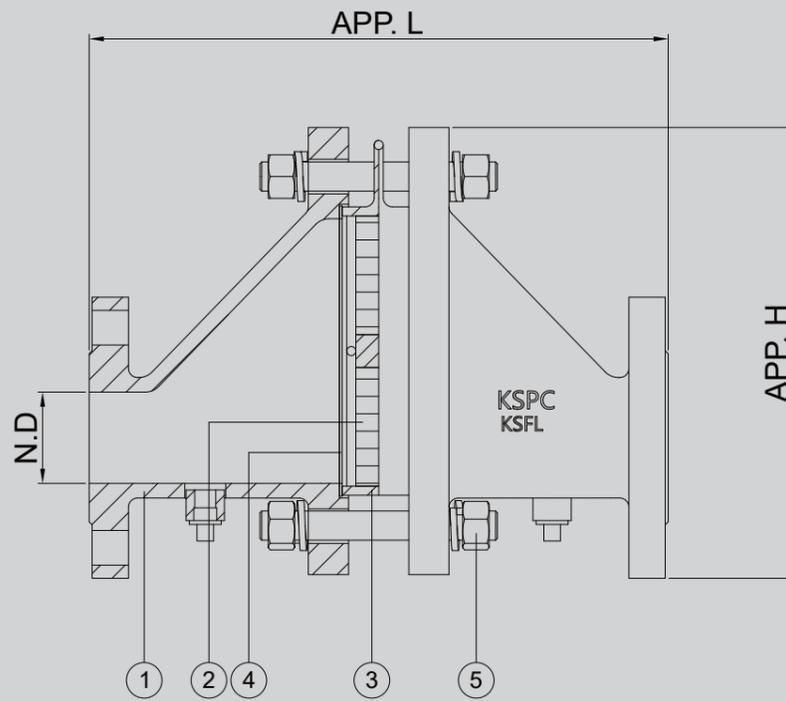

KSFL

Section 3.7
KSFL

DIMENSION TABLE

NOTE Standard Connection(ASME 150lb flange) and JIS or different types are available upon request.

SIZE	2"	3"	4"	6"	8"	10"	12"
N.D	50	80	100	150	200	250	300
App. L	316	320	372	412	462	620	660
App. H	247	276	335	399	488	639	705

COMPONENT MATERIAL

NOTE Other materials are available upon request.

ITEM NO	COMPONENT	CARBON STEEL	STAINLESS STEEL
1	BODY	CAST or WELDED C.S	CAST or WELDED S.S
2	ELEMENT	SS316L	
3	ELEMENT HOUSING	SS304L	SS304L or SS316L
4	GASKET	PTFE (NOTE)	
5	STUD BOLT/NUT	A193-B7 / A194-2H or STAINLESS STEEL	
STANDARD PAINTING		IN-OUT SIDE URETHANE 150 MICRON WITHOUT S.S & AL PART	

MAINTENANCE

- ⚠ Periodic inspection and maintenance is required. The cell assembly can be removed for cleaning purposes.
- ⚠ Cleaning can be accomplished by dipping the entire cell assembly into an appropriate solvent.
- ⚠ Care should be taken not to damage the cell openings as such deformations hamper the flow through the cell.
- ⚠ The gaskets should be inspected and replaced if necessary.